

DER Interconnection Cohort Meeting 2: Queues, Timelines, and Costs

May 27, 2026



Objectives

Cohort objectives

- Support an interested group of utility regulatory commissions to better understand DER interconnection practices and advance solutions
- Provide participants with practical information and actionable templates, frameworks, and model language for jurisdictions to adapt for their specific circumstances
- Support peer-sharing and continuous learning

Today's objectives

- Provide insights into DER interconnection data availability and uses, such as year-to-year queue project carry over rates, length of interconnection steps, and costs by project size and location
- Explore how states can collect and employ data to implement solutions for managing clogged interconnection queues, long wait times, and high interconnection costs.



Agenda

- Welcome
 - Brief overview of i2X initiative and cohort plan
 - Participant introductions & check-in question
- Presentation from Kathryn Chelminski on data transparency
- Exploring interconnection solutions - reporting requirements
 - Review sample data reporting requirements and templates
 - Discussion on data reporting requirements
- Closing and next steps



Energy Markets & Planning
BERKELEY LAB



**INTERCONNECTION
INNOVATION e-XCHANGE**
U.S. DEPARTMENT OF ENERGY



Preview: Discussion on Reporting Requirements

- If your state has requirements in place, which data have you found most valuable and how are you using it?
 - What has worked well in your state to facilitate effective reporting and data transparency?
 - What lessons would you share from your experience or what would you like to improve on?
- If your state doesn't have requirements in place, what steps would allow your commission to introduce these types of requirements?
 - Which data do you feel are most critical to start collecting?
- What ideas do you have after today's presentations to improve data reporting in your state?
 - What actions could you take based on the information?
- Would your state benefit from a data reporting template that could be adapted with appropriate modifications?



Overview of i2X Initiative and Cohort Plan



i2X Mission and Key Elements

To enable **simple**, **fast**, and **affordable** interconnection while enhancing the **reliability** and **security** of our electric grid.



Strategic Roadmaps




Stakeholder Engagement



Data & Analytics




Research & Innovation

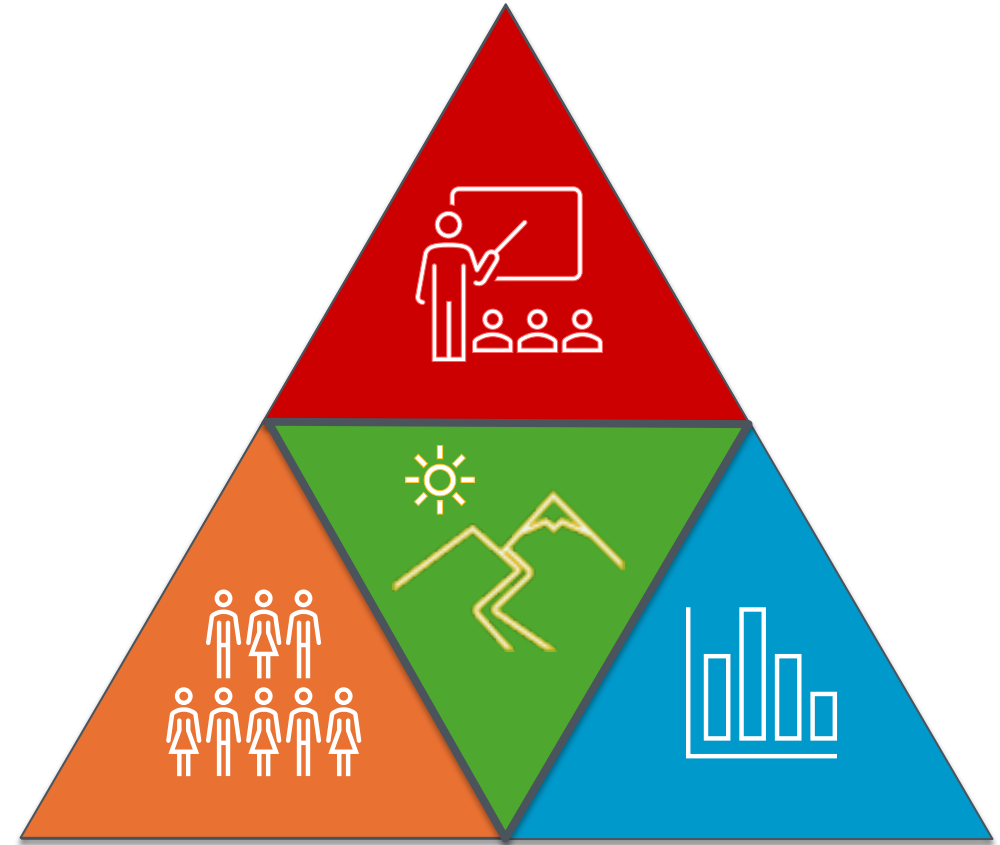

Berkeley Lab Resources

- Berkeley Lab is conducting research and developing tools on a variety of DER interconnection topics.
- Forthcoming technical documents
 - Cost allocation for grid upgrades
 - DER interconnection queues, timelines, and costs
- Additional resources
 - Forthcoming U.S. DOE report to Congress and [slide deck](#) on automating DER interconnection
 - Forthcoming DER interconnection portal on queues, timelines, and costs
 - Forthcoming cost allocation toolkit with model documents, checklists, and calculator
 - Educational trainings and webinars (including slides and recordings)
 - Technical assistance for states

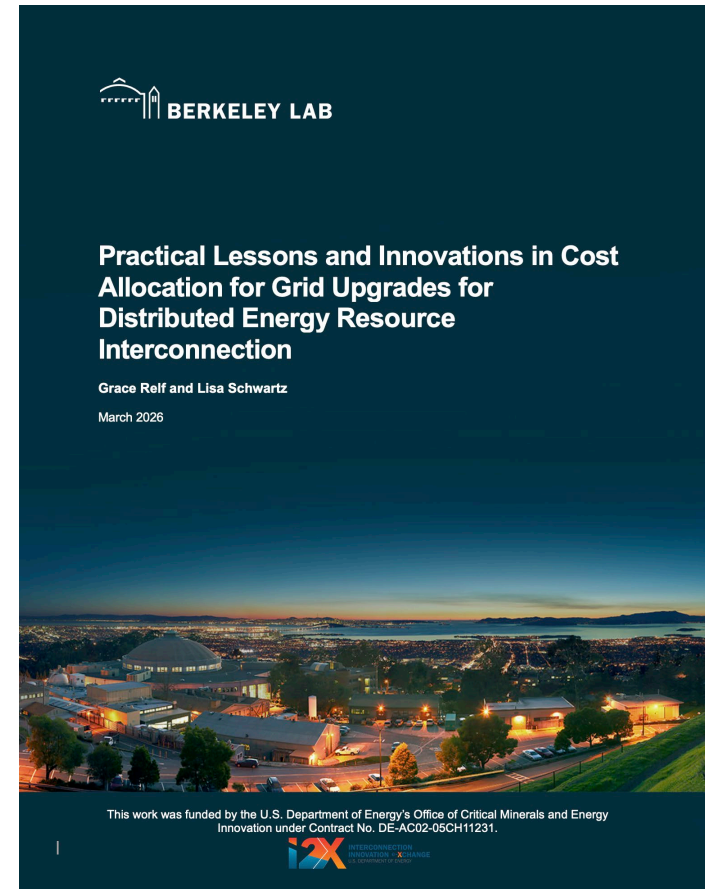

Find out more: <https://emp.lbl.gov/interconnection-innovation-e-xchange>



NARUC's DER Interconnection Cohort - Overview

Topics and activities

- Using questionnaire responses, we've identified participants' major DER interconnection challenges and topics of interest.
- Responses also informed the variety of approaches we'll use to support learning and progress on identified topics.
- We welcome your input and feedback at any time to make this as useful as possible.


Expectations

- Engage actively by attending as many meetings as possible and participating generously in conversations.
- Create a collaborative space by sharing openly and respecting others' contributions.



Questionnaire Results – Interconnection Challenges

What are the primary DER interconnection challenges in your state?

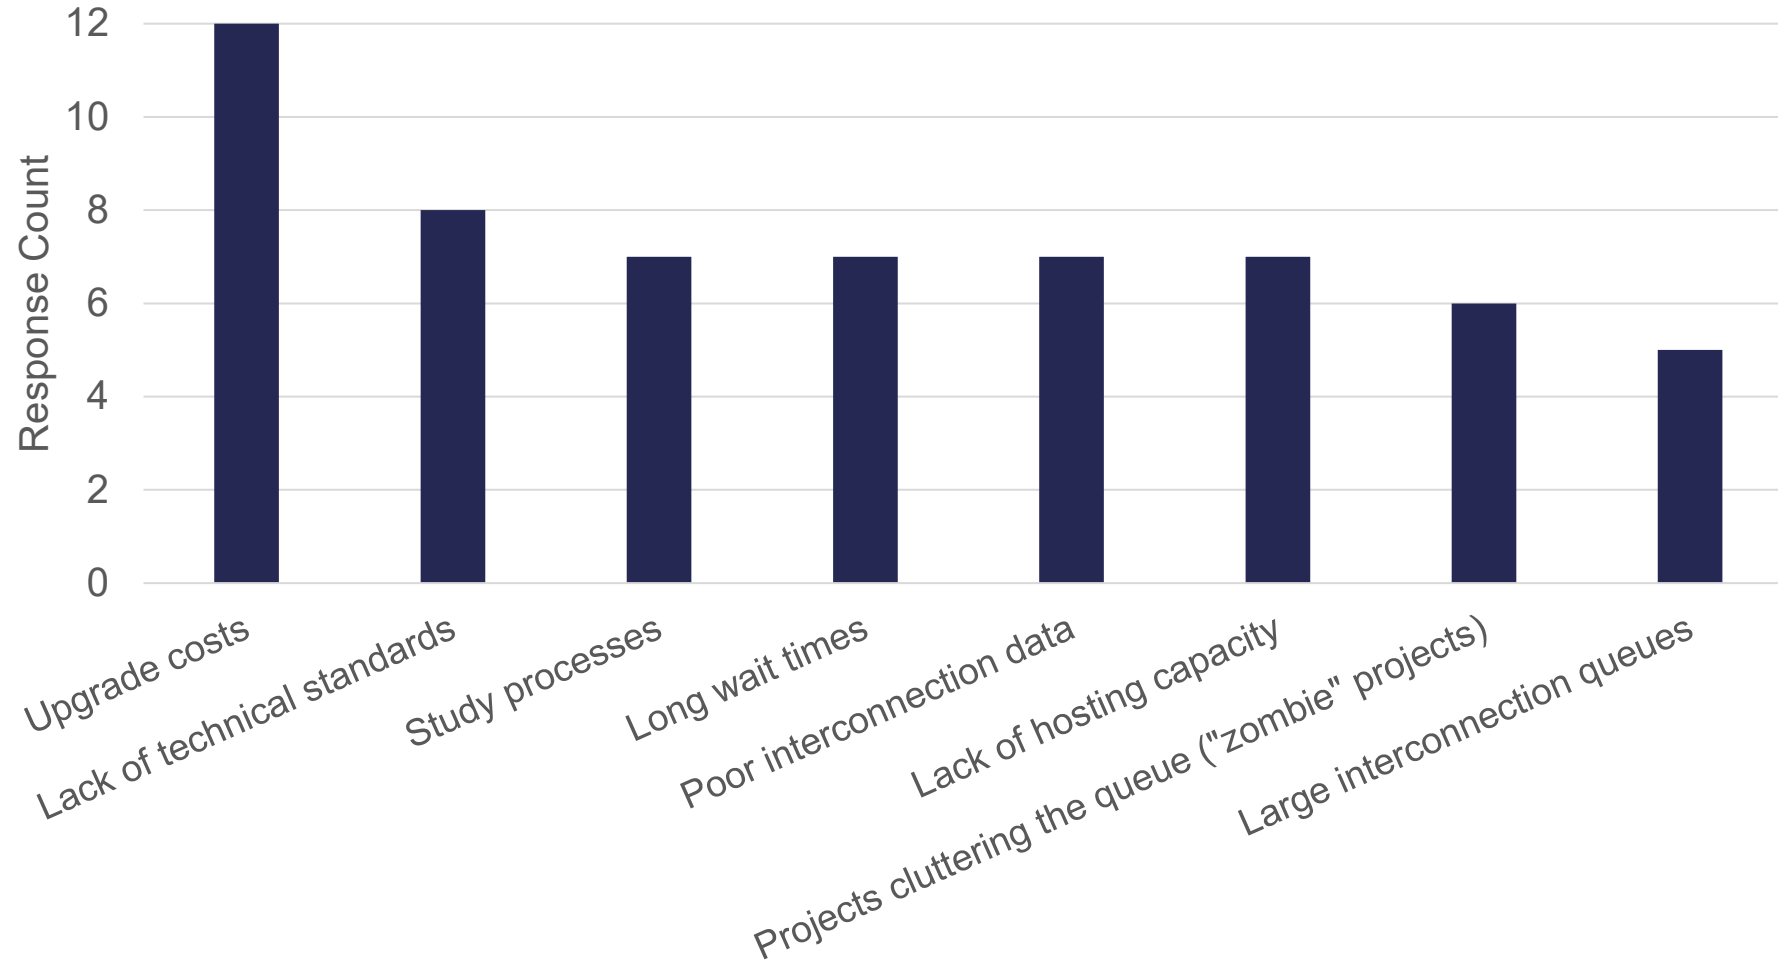

Questionnaire Results – Topics of Interest

What topics are of interest to you related to DER interconnection?



Questionnaire Results – Activities of Interest

What initiative activities would be beneficial for your commission?



Questionnaire Results – Other Insights

- Additional challenges and topics of interest include
 - Updating interconnection rules
 - DER compensation rates and transition from net energy metering
 - Strategic deployment of DERs to avoid capital expenditures (e.g. as non-wires alternatives or in response to large load additions)
 - Dispute resolution and communication between utilities, installers, and customers
 - Improving commission technical expertise
 - Commission processes for addressing interconnection issues (e.g. working group processes)



Resulting Cohort Plan

- Meetings are monthly through September, from 3 – 4:30 pm ET.
- Topics to address key participant needs are:
 - **Today:** Interconnection Queues, Timelines, and Costs - Data Transparency
 - Responsive to challenges with poor data and long wait times and interest in data transparency and queue management
 - **June 23rd:** Managing Interconnection Costs Part 1 - Cost Allocation
 - Responsive to challenges with high upgrade costs and lack of hosting capacity and interest in cost allocation
 - **July 29th:** Managing Interconnection Costs Part 2 - Distribution System Planning (DSP) and Capacity Expansion Modeling
 - Responsive to challenges with high upgrade costs and lack of hosting capacity and interest in coordination with DSP
 - **August 26th:** Interconnection Technical Standards, Studies, and Commission Processes for Improving DER Interconnection
 - Responsive to challenges with lack of technical standards and study processes and interest in updating interconnection rules, standards, and study techniques
 - **September 23rd:** Peer and Expert Coaching on Participant Questions, Follow-Ups from Past Meetings, and Additional Topics
 - May cover additional technical topics of interest in addition to follow-ups and coaching
- Commissioners and state agency staff can register for each of the meetings on [NARUC's webpage](#).



Participant Introductions

Please say your name, agency, role, and a brief response to the check-in question:

Do utilities in your state report publicly on DER interconnection queues, timelines, and costs?



Presentation on Data Transparency – Queues, Timelines, & Costs





Energy Markets & Planning
BERKELEY LAB

Timelines and Costs for Distributed Energy Resources Interconnection in the United States (2000-2025)

Kathryn Chelminski

Presentation to NARUC/LBNL Distributed Energy Projects Cohort

May 27, 2026

The U.S. Department of Energy's Interconnection Innovation Exchange (i2X), sponsored by the Office of Critical Minerals and Energy Innovation, supports this work under Contract No. DE-AC02-05CH11231.

Agenda

- Data Sharing Practices
- Research Overview
- Key Findings
- Solutions
- Conclusions

Additional findings in forthcoming report by Kathryn Chelminski, Johnny Wong, Lisa Schwartz, Margaret Pigman, and Katherine Carlson

Measurable Success Targets for 2030 for Timing, Access and Data

	Target	System Size*	2030 Target Value
Timing	(1) Median time from DER interconnection request to agreement [§]	< 50 kW	Within 1 day [†]
		50 kW–5 MW	< 75 days
		≥ 5 MW	< 140 days
Access	(2) Completion rate from entering the queue to execution of interconnection agreement	< 50 kW	> 99%
		50 kW–5 MW	> 90%
		≥ 5 MW	> 85%
Data	(3) Availability of public state-level interconnection queue data	All	50 states, Washington, D.C., and territories have public, detailed, and current queue data

* System size thresholds will vary across utilities and jurisdictions.

[§] For systems that do not trigger system upgrades.

[†] Defined as 1 business day.

Source: [U.S. Department of Energy](#) (2025)

Data Sharing Practices

Data Sharing Practices

- Data sharing practices vary across the United States.
 - ▣ Detailed public interconnection data are not widely available across the country ([Cadmus 2024](#)).
 - ▣ Even when utilities provide data, many data fields are missing — e.g., costs, status, capacity, and technology type.
 - ▣ The types and frequency of data sharing are not standardized, aside from common agreement on the need for adoption and compliance with IEEE 1547-2018 ([NARUC 2023](#); [Ingram et al. 2021](#)).
 - ▣ Publicly available data are often a result of state requirements for data sharing and standardization.

- Major barriers to data sharing and data collection include:
 - ▣ Labor and resources needed to collect, aggregate, clean and standardize the data,
 - ▣ Computing requirements for data collection and sharing, and
 - ▣ Privacy and security of the data ([Ingram et al. 2021](#)).

Interconnection Data Are Vital to DER Deployment

- Transparent, publicly available data on interconnection projects, timelines, and costs are vital for economically efficient deployment of distributed energy resources (DERs) and to evaluate utility interconnection performance and process improvements over time.
 - Lack of quality data hinder DER siting decisions and can lead to interconnection delays and high upgrade costs
- Publicly available data are necessary for benchmarking and tracking ([Brown and Stanfield 2022](#))—for example:
 - Queue statuses
 - Timelines for various interconnection phases
 - Costs by project size and type

- Utilities require customers and third-party developers to provide data for reviewing interconnection applications and conducting any technical studies that may be needed.


Common data collected in applications

- Rated power (kW)
- Stored energy (kWh)
- Technology/system type
- Location: substation/feeder
- IEEE 1547 Reactive Power Category, referred to as “voltage and reactive power capability”
- IEEE 1547 Disturbance Category, referred to as “voltage and frequency ride-through capability”

Sources: [DOE 2025](#), [BATRIES 2022](#)

Examples of Interconnection Data

- ❑ Queue position and identification number
- ❑ Cumulative queue volume
- ❑ Application date and interconnection agreement date
- ❑ Estimates of initial and final upgrade costs
- ❑ Timelines – Dates of system impact study start and completion, and construction completion date
- ❑ Group study results, if applicable
- ❑ Technical screen failures and results, if applicable
- ❑ Application status (next slide)

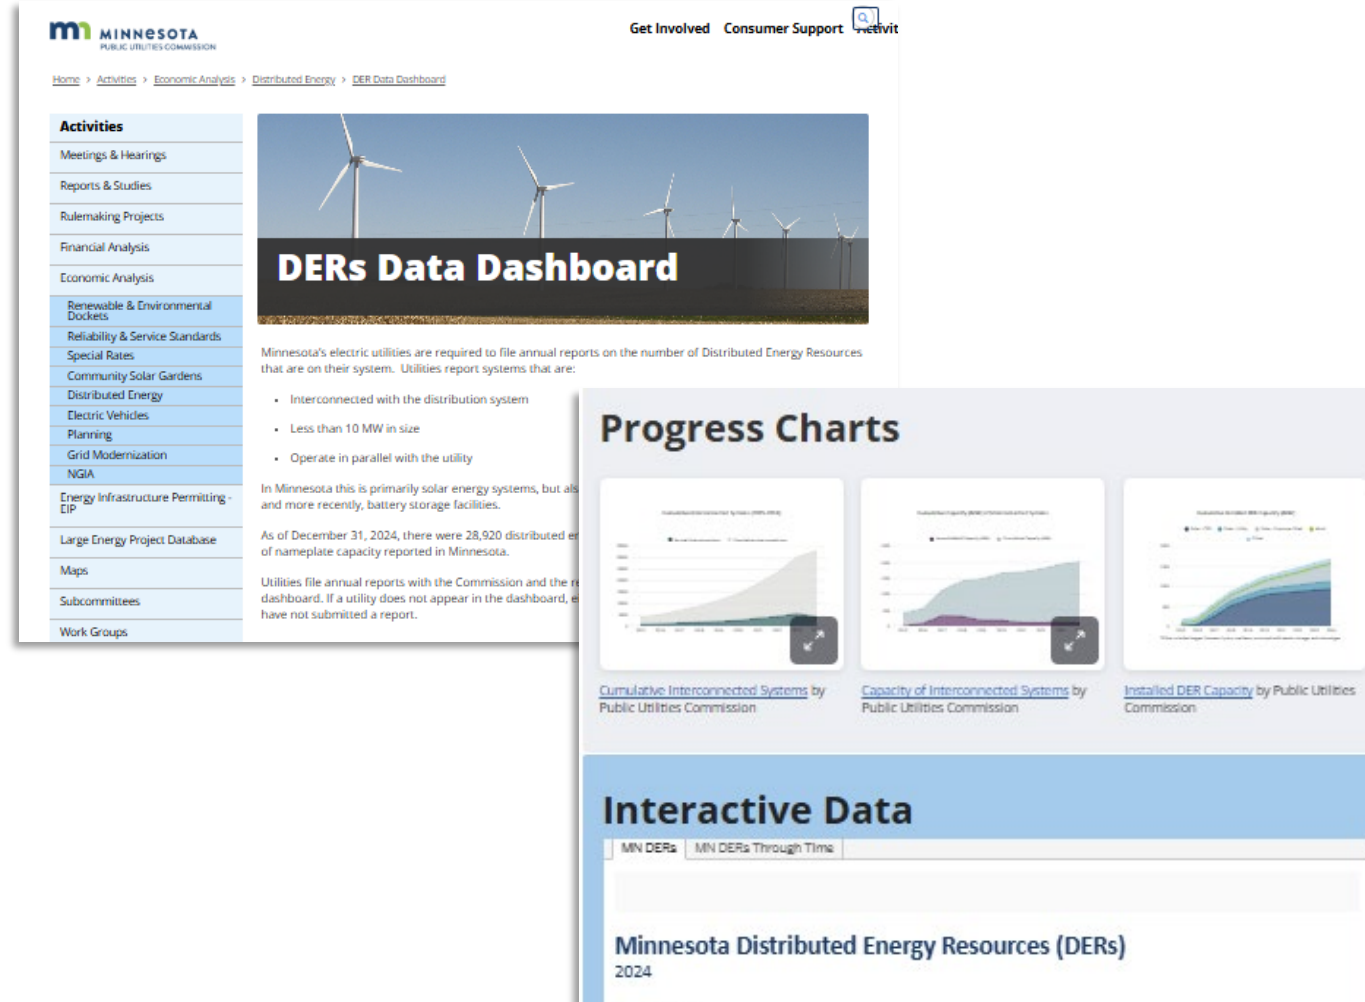

Source: [MN PUC DERs Data Dashboard](#)

Application Status

Application Status	Description
Application	Interconnection application received by utility
Under Study/Review	Project is undergoing a technical review or study
Interconnection Service Agreement (ISA)	Interconnection service agreement has been executed or is under review
Design and Construction	Project interconnection design or construction is underway
Finalization	Witness test, commissioning, and other final steps directly prior to project placed in service
Permission to Operate (PTO)	Permission to operate or in service date
On Hold	Project is on hold in interconnection queue
Cancelled/ Decommissioned/ Withdrawn	Project is either cancelled, withdrawn, or decommissioned



Research Overview

Methodology

- LBNL explored DER interconnection projects, timelines, and costs across the country—specifically:
 - How do interconnection metrics vary across states, project sizes, technology types, and over time?
- LBNL collected data for 188 utilities in 24 states during the period 2000–2025* and conducted quantitative analysis of trends over time.
- The dataset includes the following DER technologies:
 - Biomass/biofuels, coal, geothermal, hydropower, natural gas/oil, nuclear,** solar, storage, wind, hybrid^, and other
 - “Other” includes steam turbines, fuel cells, hydrogen, combined heat and power, and bidirectional electric vehicle chargers.
- The analysis includes distribution-connected projects up to 50 MW.†
- The dataset includes all metering configurations (offsite/virtual, behind the meter, paired, islanding-capable).
- To provide context for the findings, LBNL interviewed utilities, regulators, and industry stakeholders, as well as incorporated insights from LBNL’s i2X webinar series on DER interconnection.

*The dataset does not represent comprehensive data for 2025. LBNL acquired some datasets prior to the end of 2025.

**The dataset includes one nuclear project.


^“Hybrid” represents microgrids and any other project that includes more than one type of technology.

† The dataset includes only distribution and sub-transmission level projects between 1 kW and 50 MW.

Data Collection

- The project focuses on quantitative analysis, using data primarily from two sources:
 - *Public websites* hosted by utilities, public utility commissions, and state energy offices – LBNL collected this data in summer 2025.
 - *Data from Interconnection.fyi*, through a non-disclosure agreement (NDA) – LBNL used this data, as of February 2026, when it was more detailed than information from public websites.
- LBNL also collected data directly from state agencies and utilities, including some data under NDAs with utilities (November 2025–January 2026).
- Public data are not available for all states, and even states with public data do not provide data for all utilities.

DER Interconnection Dataset Overview

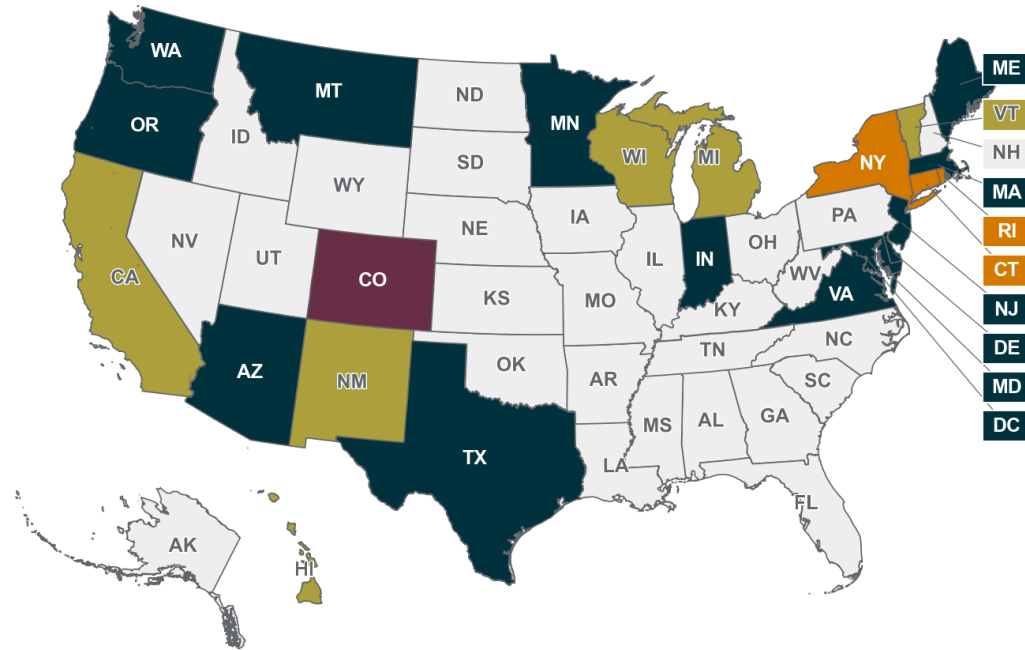

Data Availability

- Timeline, Cost & Queue Data
- Timeline & Queue Data
- Cost & Queue Data
- Queue Data Only
- No Data

Data Availability and Count of Projects by Metric

	General Information on DER Interconnection Dataset	Timeline (Days to ISA)	Timeline (Months to PTO)	Upgrade Costs
States	24	8*	15**	4
Utilities	188	36	28	10
Total Projects	2.73 million	237K	574K	226K

*States with timeline data (application to ISA): CT, DC, MA, ME, MN, NJ, RI, VA

**States with timeline data (application to PTO): AZ, CT, DC, DE, IN, MA, MD, ME, MN, MT, NY, OR, RI, TX, WA

^States with upgrade cost data: CO, CT, NY, RI

Data Limitations

- Each state/utility has different standards for sharing data publicly, including the type of data shared and cadence.


- Data reporting methods vary by jurisdiction, which can make comparisons difficult.
 - The datasets LBNL collected required extensive standardization across technology types, interconnection statuses, dates, and types of costs, among other data fields.

- The data fields in interconnection reports filed by regulated utilities are not standardized—for example:
 - Most utility datasets did not include information on the cost of required distribution system upgrades.
 - Not all datasets include the same timeline metrics, which makes it challenging to analyze timelines.

Key Findings

Summary of Interconnection Project Data (1)

- The interconnection queue data are heavily represented by California, which makes up 65% of the data, followed by New York (11%), Arizona (10%), and New Jersey (9%).
- The interconnection status of the majority of projects in the queue in a given year is *permission to operate (PTO)*—when a project is allowed to connect to the grid or is in service.

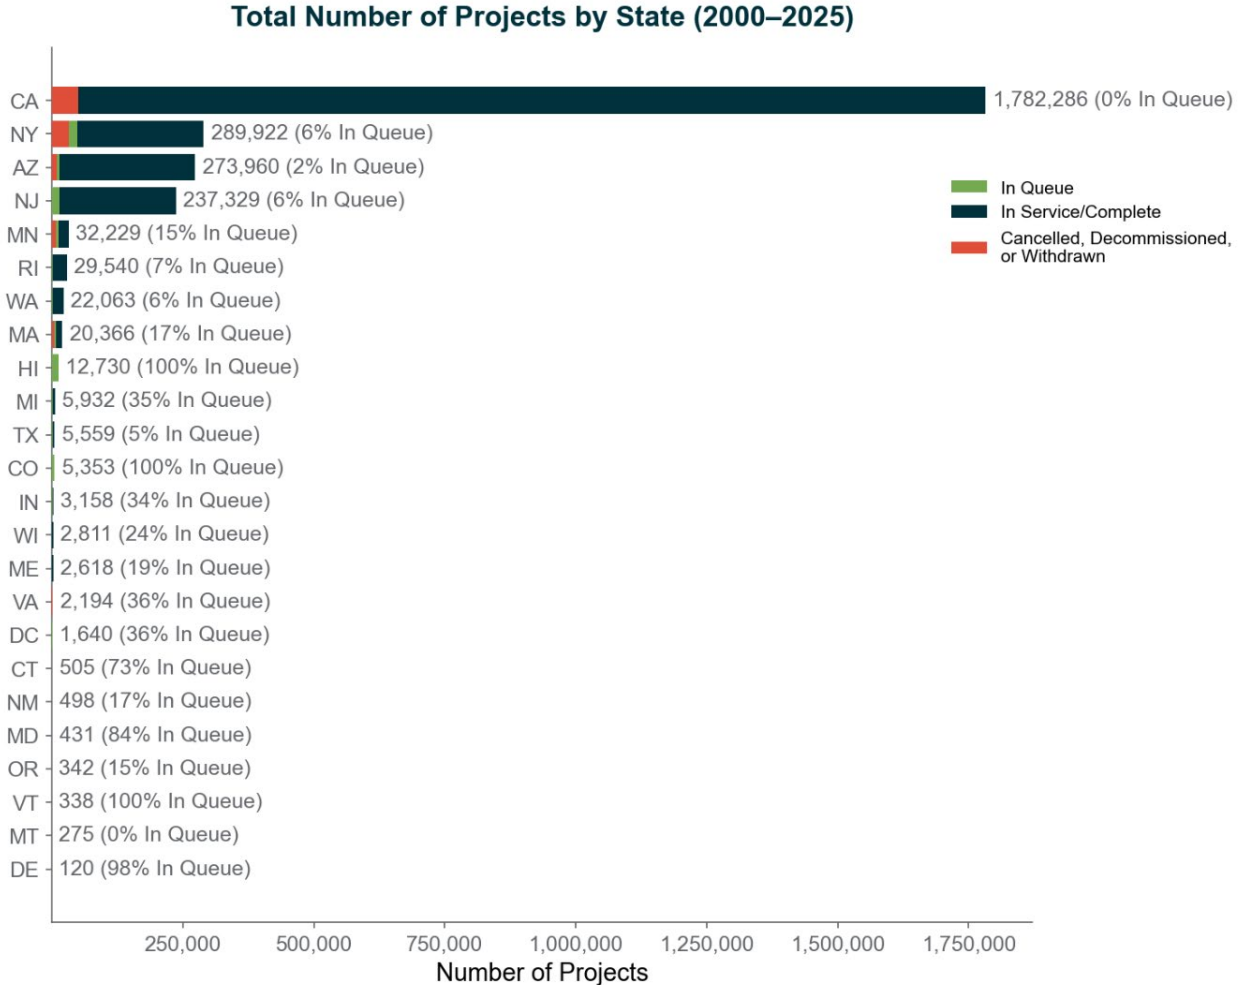


Summary of Interconnection Project Data (2)


□ The majority of DER interconnection projects in the dataset are solar (66%), representing nearly 78 GW of capacity, followed by hybrid systems (12%, 14 GW), “other” technologies (2%, 3 GW), and storage systems (7.5%, 9 GW).

□ Small systems (<30 kW), typically residential, make up the majority of projects in the dataset (~97%).

DER Interconnection Project Data by Technology (2000-2025)

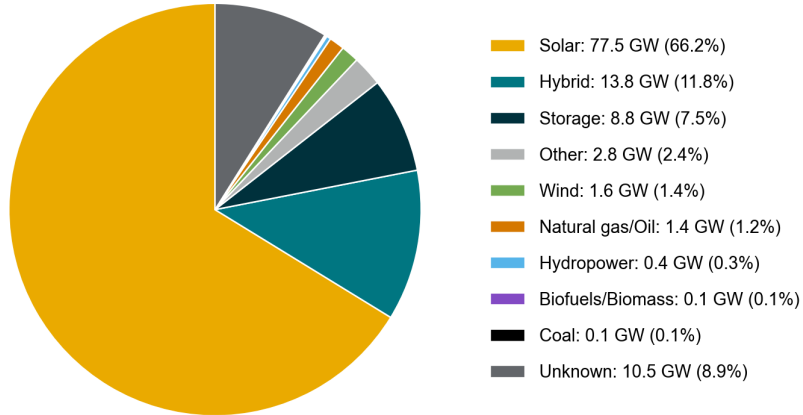

Share of Project Counts by Project Capacity Size (2000-2025)


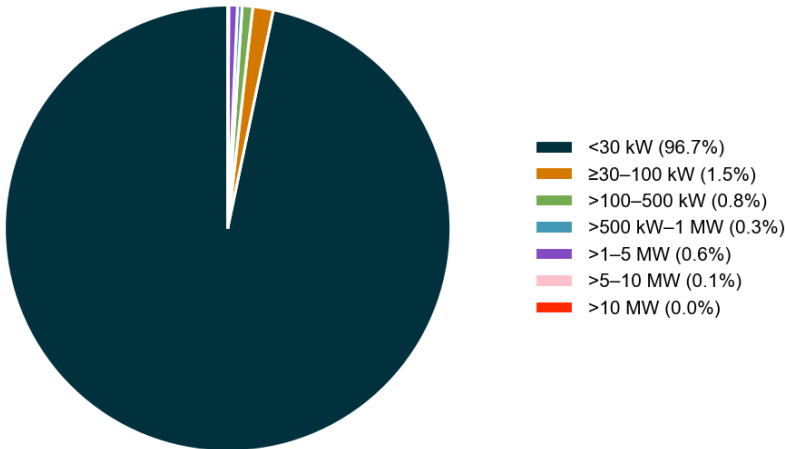


Project Type	Share in Database	Capacity (GW)
Solar	66%	77.5 GW
Hybrid	12%	13.8 GW
Storage	7.5%	8.8 GW
Other	2.4%	2.8 GW
Wind	1.4%	1.6 GW
Natural gas/Oil	1.2%	1.4 GW

Unknown technologies are for projects that did not specify the technology type. Hybrid systems are any project with more than one technology, including microgrids and combinations of biomass, coal, diesel, fuel cells, fuel oil, geothermal, hydropower, hydrogen, natural gas, wind, solar, and storage. “Other” includes steam turbines, fuel cells, hydrogen, combined heat and power, and bidirectional electric vehicle chargers.

Interconnection Timelines (1)


- The figures depict an analysis of the timeline duration of a project moving through interconnection processes by application year and by project size.
- The share of projects in the queue generally increases as project size increases.
 - For example, 46% of projects <30 kW were PTO in 31-90 days between 2020-2025, but <1% of projects >100 kW–10 MW were PTO in 31-90 days during the same period.
 - The majority (86%) of larger projects (>1-5 MW) remained in interconnection processes without achieving PTO during the period 2020-2025.

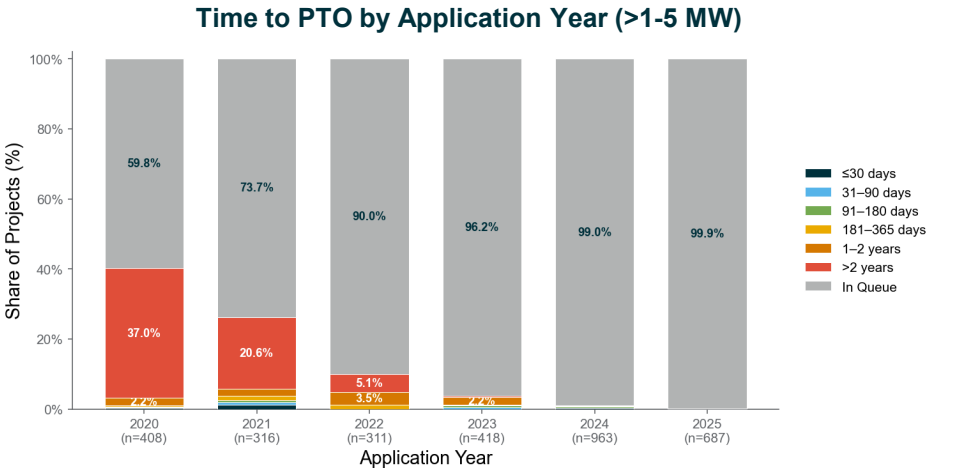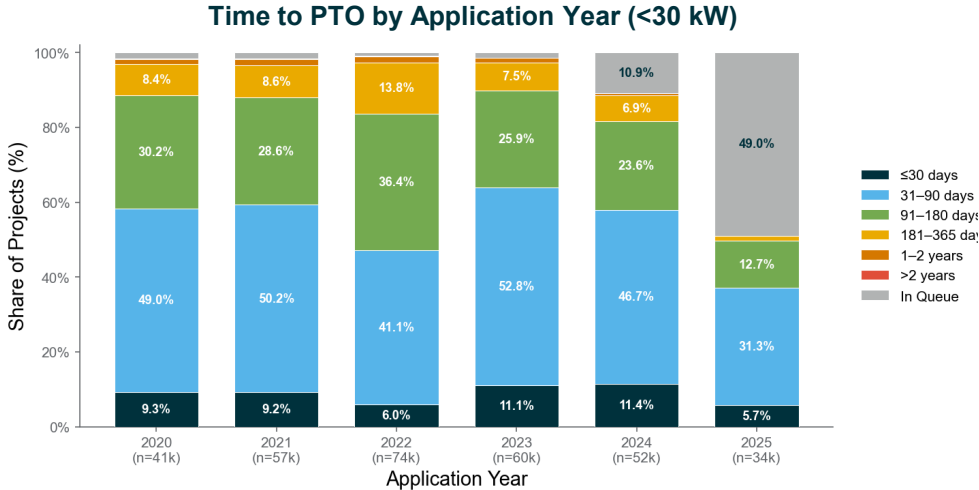

States represented in the sample include AZ, CT, DC, DE, MA, MD, ME, MN, MT, NY, OR, RI, TX with majority of the data representing NY (55%) and MD (11%) and MA (11%).

The data for <30 kW figure heavily represent Arizona (42%) and New York (39%). The data for >1-5 MW figure heavily represent New York (55%). The totals for each bar are impacted by the sample for each year.


Interconnection Timelines (2)

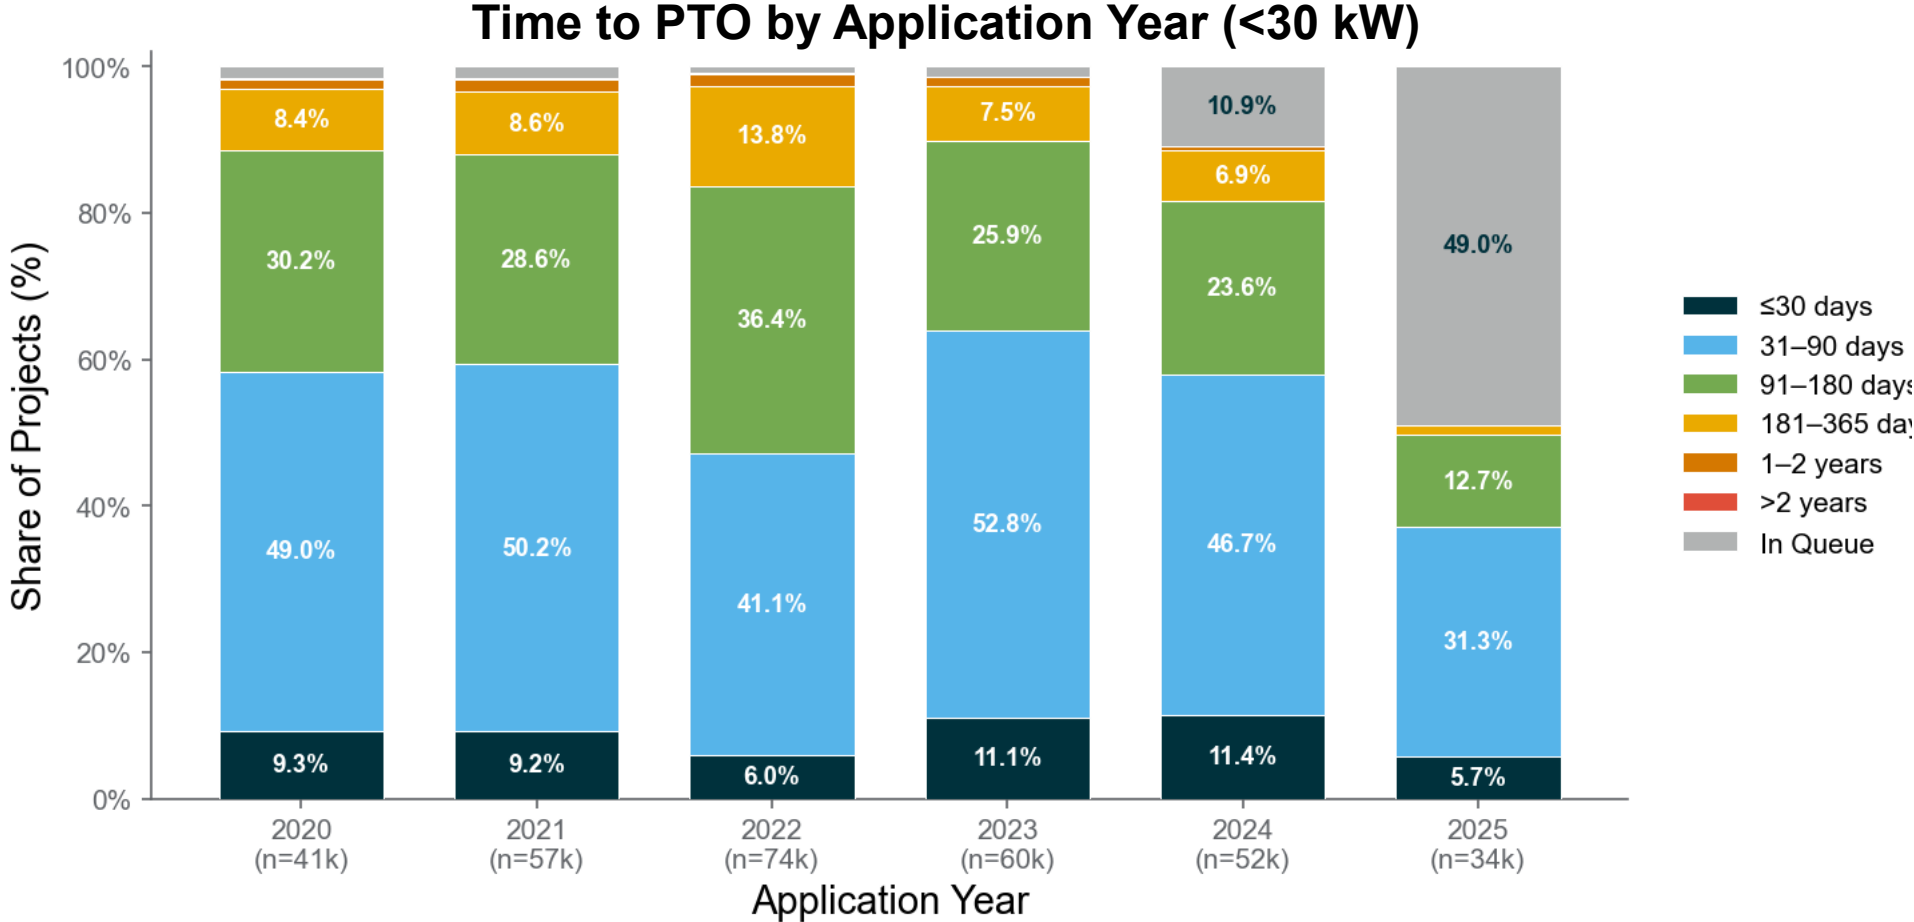

The data heavily represent Arizona (42%) and New York (39%). The totals for each bar are impacted by the sample for each year.

Interconnection Timelines (3)


Time to PTO by Application Year (>1-5 MW)

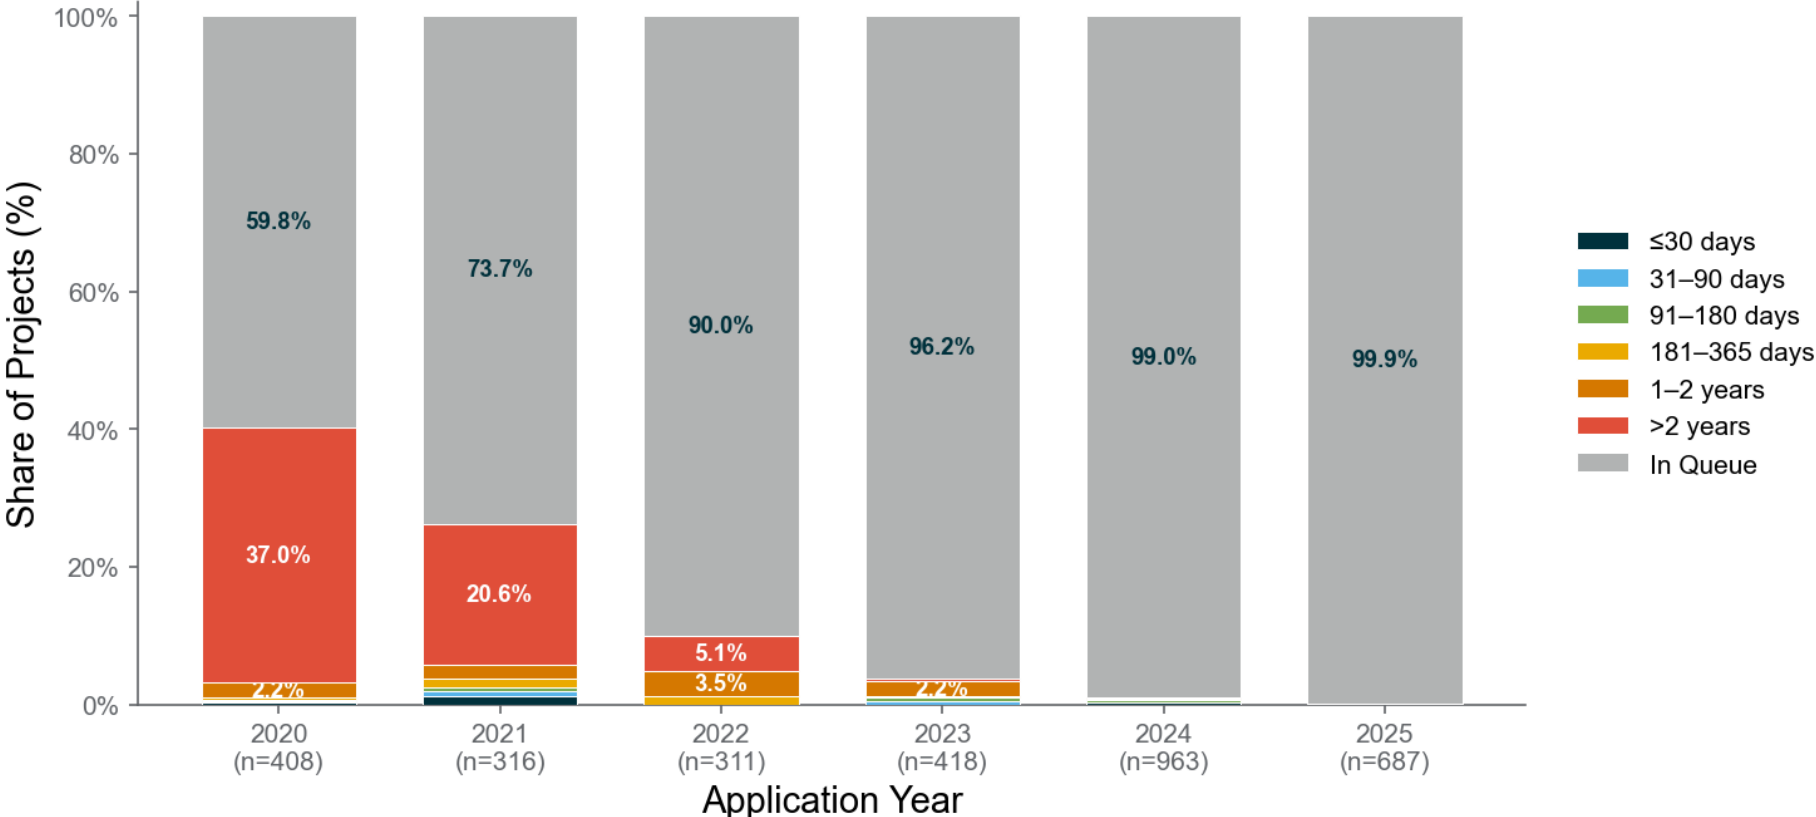

States represented in the sample include AZ, CT, DC, DE, MA, MD, ME, MN, MT, NY, OR, RI, TX with majority of the data representing NY (55%) and MD (11%) and MA (11%).

The data heavily represent New York (55%). The totals for each bar are impacted by the sample for each year.

Interconnection Timelines (4)

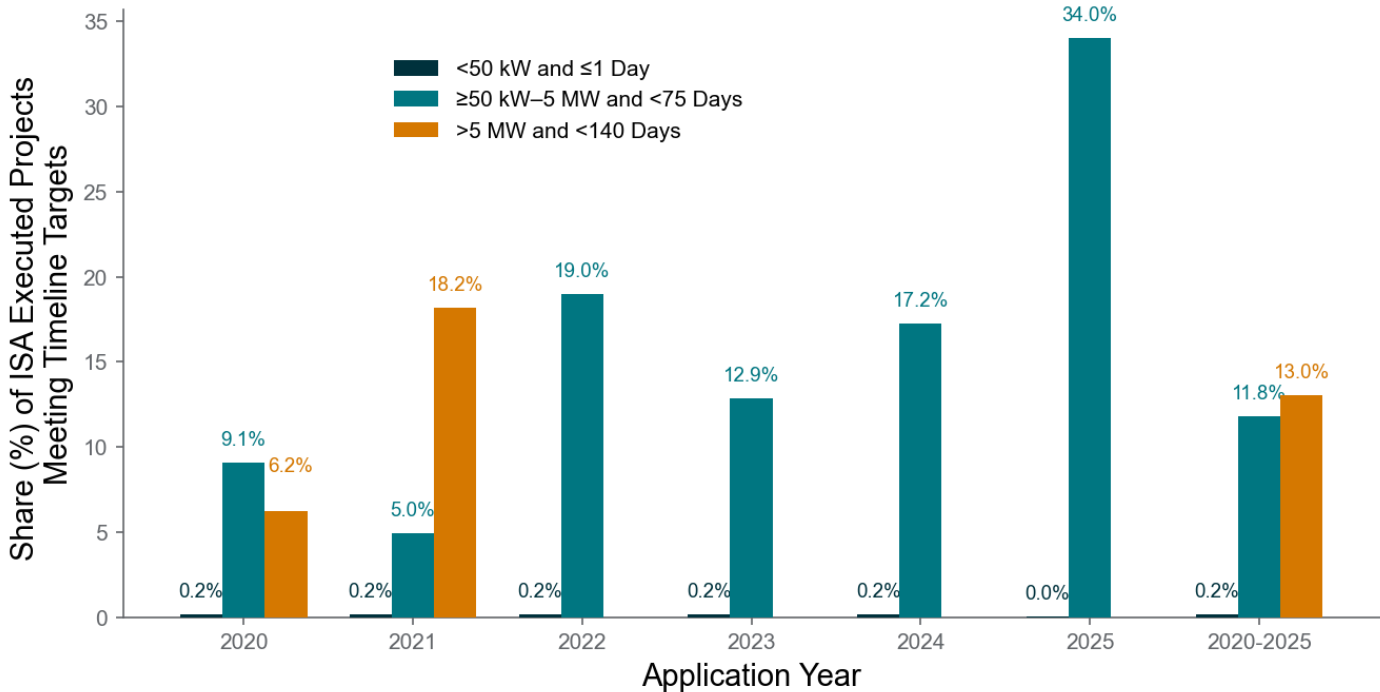


- Using metrics [established by DOE](#) to improve DER interconnection timelines by 2030, LBNL analyzed timeline data to determine the share of projects that applied for interconnection between 2020-2025 and achieved ISA execution.
 - Virtually no projects <50 kW met the target for executing an ISA within 1 day.
 - 12% of projects ≥50 kW-5 MW met the target of executing an ISA in <75 days.
 - 13% of projects >5 MW met the target of executing an ISA in <140 days.

Bars with no or insufficient data (<10 projects) are excluded.
 92% of the data for this analysis is for NJ projects.


Interconnection Timelines (5)

- ❑ The median timeline from application to PTO, for all project sizes and technologies, was less than four months from 2000-2025.
- ❑ These results match the median and mean timelines for small projects (<30 kW), which make up 97% of the dataset.
- ❑ Median timelines from application to PTO for projects >1–5 MW more than doubled between 2000 and 2018, but have significantly improved since then.

Months From Application to PTO for Projects <30 kW (2000-2025)¹

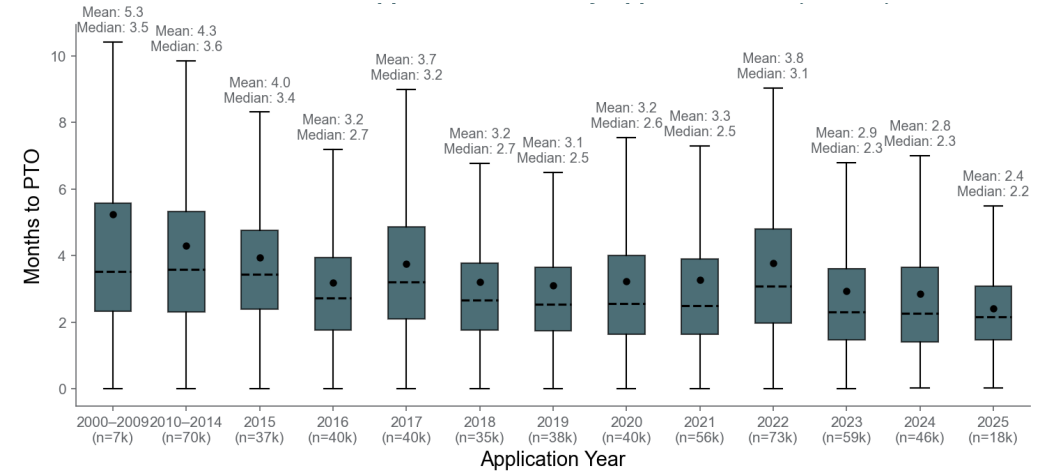

Months From Application to PTO for Projects >1-5 MW (2000-2024)²

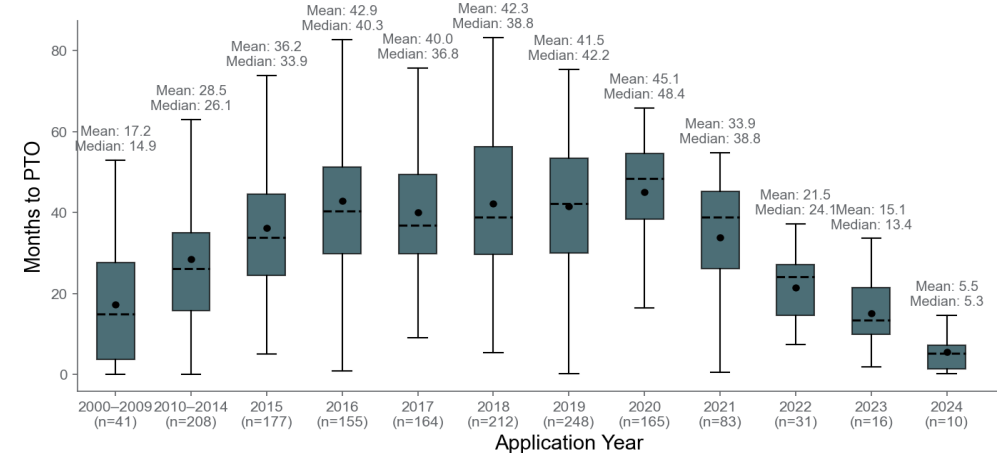


¹States represented include: AZ, DC, IN, MA, ME, MN, NY, RI, TX, WA, but the majority of data is represented by AZ data (46%) and NY data (42%).

²States represented include: AZ, CT, DC, DE, MA, MD, ME, MN, MT, NY, OR, RI, but the majority of data is represented by NY data (59%) and MA data (27%).

Cut-off date for sample collection biases timelines in 2024 and 2025. We excluded 2025 from the >1-5 MW figure because there is only one project.

Total Upgrade Costs (1)

Average Upgrade Costs per kW by Project Size and Status (2015–2025)

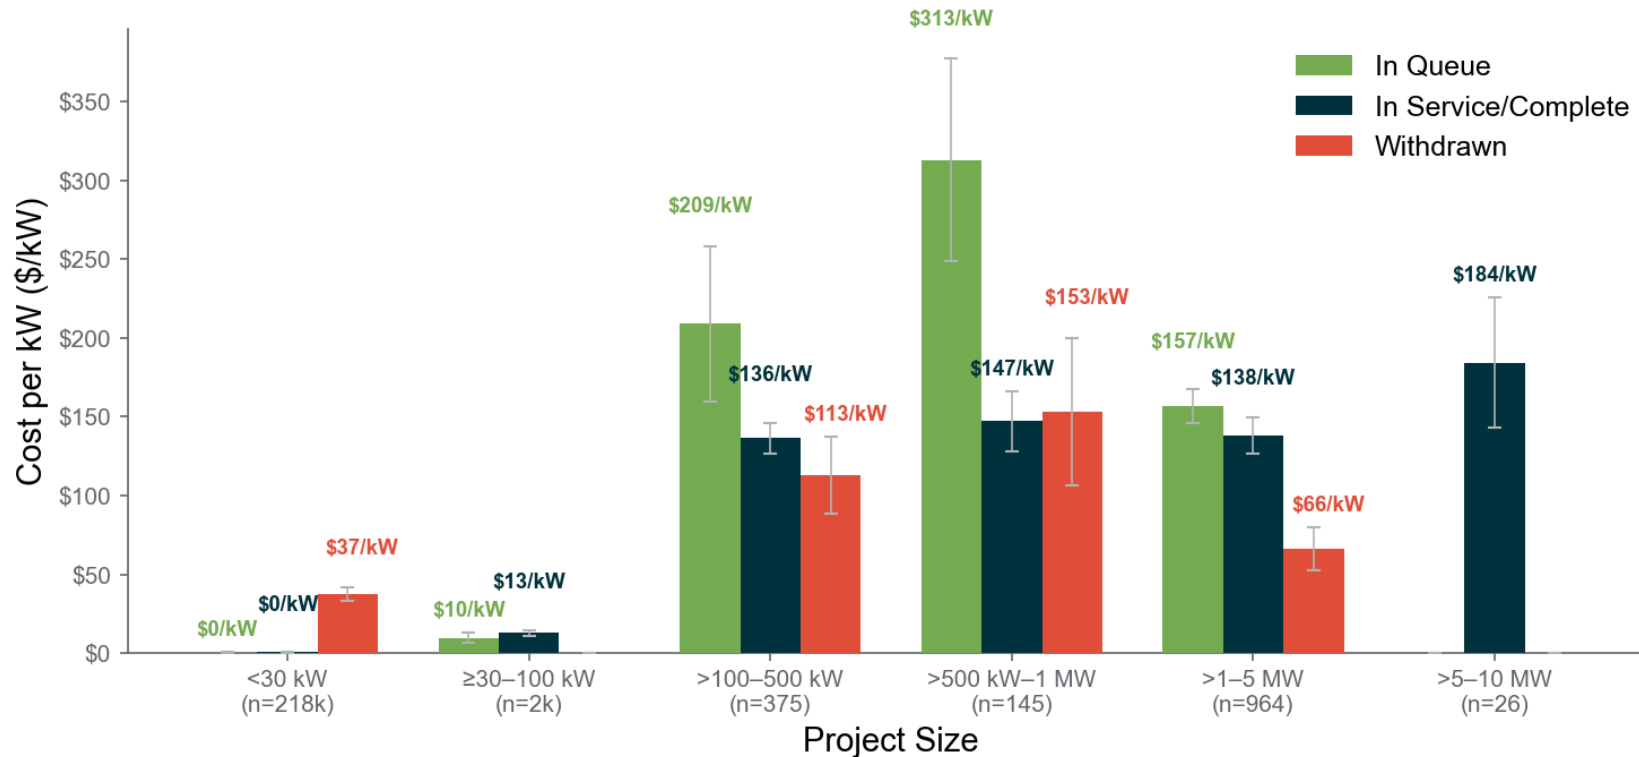


States represented in the cost data sample: CO, CT, NY, RI. NY represents >99% of the cost data. The figure excludes bars where the sample size is less than 10 projects.

- The cost data represent distribution system upgrade costs *paid by DER interconnection customers*.
- High upgrade costs (per kW) for projects <30 kW are associated with withdrawal of projects from the queue.
- Average upgrade cost per kW of withdrawn projects was lower for projects >1–5 MW than projects >100 kW–1 MW.

Total Upgrade Costs (2)

Median Upgrade Costs by State and Project Size (2015–2025)

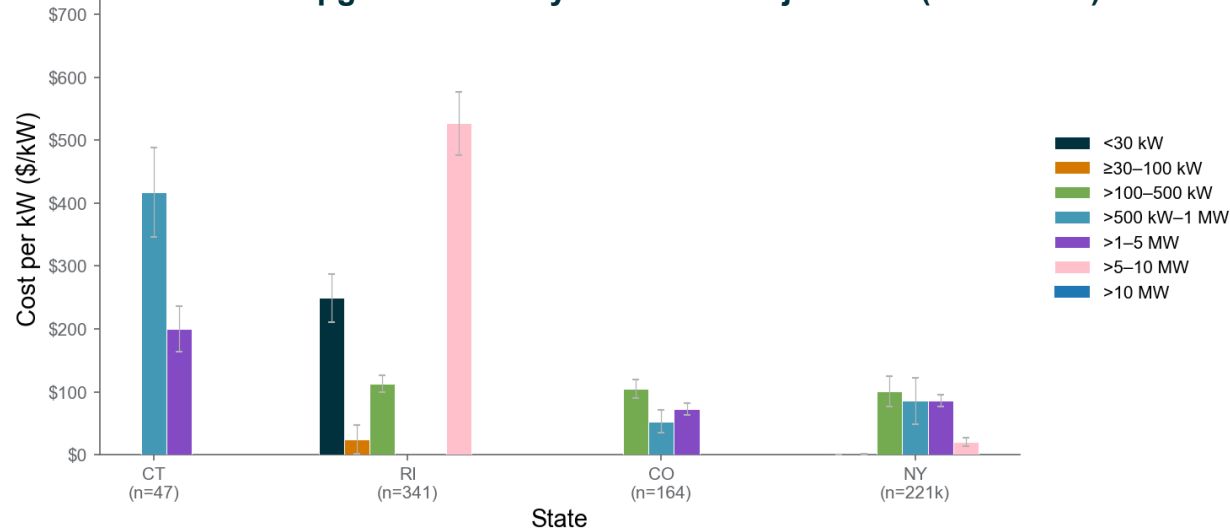

- ❑ Median upgrade costs were lowest overall in New York,* followed by Colorado.
 - ❑ Lower costs may be indicative of cost sharing mechanisms, particularly in New York.
 - ❑ However, costs vary by project size.


Median Cost per kW (2015-2025)								
State	<30 kW	≥30–100 kW	>100–500 kW	>500 kW–1 MW	>1–5 MW	>5–10 MW	>10 MW	Overall
CT				\$417	\$200	\$155		\$281
RI	\$249	\$25	\$113			\$527		\$173
CO			\$105	\$53	\$72			\$87
NY	\$0	\$0	\$101	\$85	\$86	\$20		\$0
Overall	\$0	\$0	\$108	\$130	\$86	\$46		\$0

*In LBNL’s sample, 99% of projects in process or in service in New York paid no upgrade costs.

The sample includes only projects in process or operating; it excludes withdrawn or cancelled projects. Cells in the Median Cost table are grayed out where data were not available or too few (<10) projects were included in a dataset.

Total Upgrade Cost (3)

Upgrade Cost per kW by Technology & Size (2015–2025)

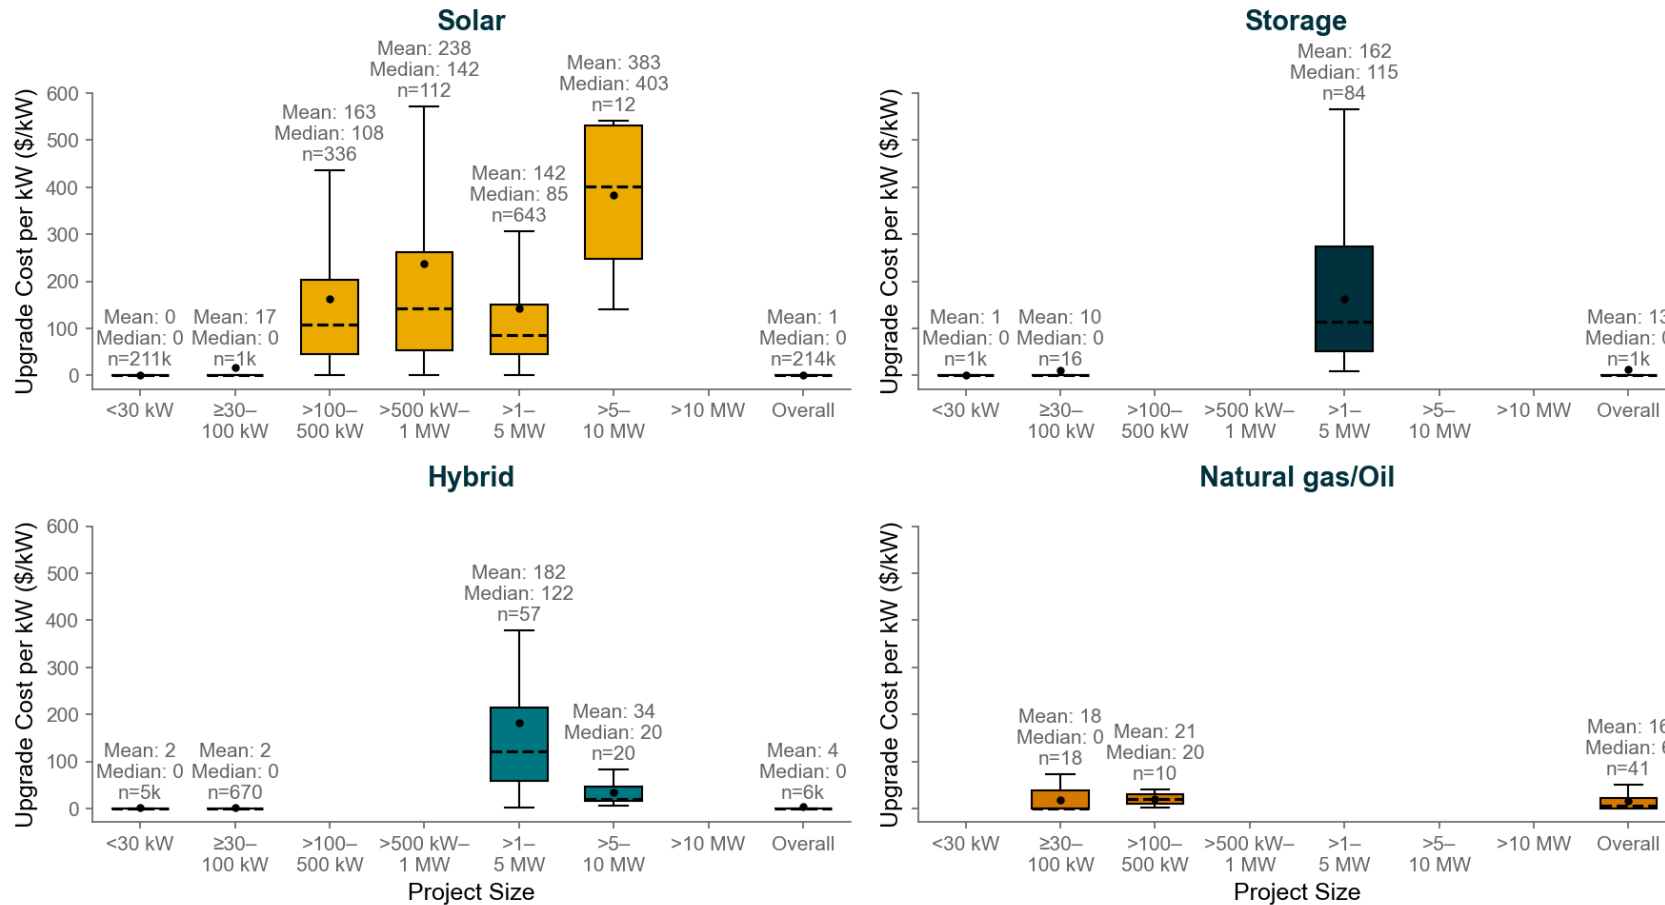

- Natural gas/oil technologies had the highest average upgrade costs overall at \$16/kW for all project sizes.
- Solar technologies had the lowest average upgrade costs overall at \$1/kW for all project sizes.
- Costs vary significantly by project size.
 - For example, solar projects >5-10 MW had the highest average upgrade costs (\$383/kW); solar and natural gas/oil projects <30 kW had the lowest average upgrade cost of \$0/kW.

The sample includes only in process or operating projects; it excludes withdrawn or cancelled projects. Majority of states represented in the sample — Solar: NY (>99%); Storage: NY (99%); Hybrid: NY (>99%); Natural gas/Oil: NY (98%). The figure excludes box plots where the sample size is less than 10 projects.

Data Sharing Solutions

Solutions for Sharing Interconnection Data

- Establish guidelines for collecting and sharing data
 - ▣ Consider trade-offs between value created, effort required, and data security and accessibility concerns
- Expand and standardize reporting of interconnection data
 - ▣ Including project attributes and interconnection cost estimates

Solutions for Timelines


- Provide pre-application educational materials and self-service options for smaller DER projects
- Establish and require that large DER interconnection applicants meet clear criteria for commercial readiness and queue dwell-time
- Implement and enforce appropriate DER interconnection study timelines and consider penalties for delays in completing studies
- Continue automating parts of DER interconnection application processing
- Implement automation, where possible, to streamline completion of interconnection studies
- Enable flexible interconnection so DERs can be used to defer grid upgrades and avoid delays in exchange for curtailing generation
- Use a group study process to address existing queue backlogs or avoid anticipated queue backlogs
- Develop and standardize an interconnection process for DERs connected to new building construction projects



Conclusions

Conclusions

- DER interconnection timelines and costs vary dramatically depending on the state, utility, project size, and technology.
- Publicly available DER interconnection data are limited across the U.S.
 - Data are not available for all states, and information on upgrade costs is available only for a few states.
 - Even in states with public data, information is not available for all utilities.
- Standardized data reporting, with regular updates, is integral to benchmarking and tracking DER interconnection performance both within and across states and utilities.
- The forthcoming LBNL DER Interconnection Dashboard will provide direct access to aggregated data and visualizations from this analysis.

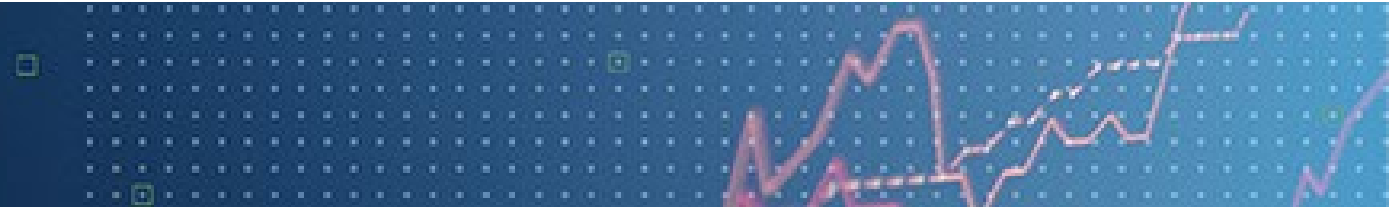

Contacts

Kathryn Chelminski: KChelminski@lbl.gov

Lisa Schwartz: lschwartz@lbl.gov

For more information

Download publications: <https://emp.lbl.gov/publications>

Sign up for our email list: <https://emp.lbl.gov/mailling-list>


Follow us on social media: [@BerkeleyLabEMP.bsky.social](https://bsky.app/profile/berkeleylabemp) and [@BerkeleyLabEMP](https://twitter.com/BerkeleyLabEMP)

Acknowledgements

The U.S. Department of Energy's Interconnection Innovation Exchange (i2X), sponsored by the Office of Critical Minerals and Energy Innovation, supported this work under Contract No. DE-AC02-05CH11231.

The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof, or The Regents of the University of California.

The authors thank DOE program managers Ammar Qusaibaty and Cynthia Bothwell for their support and input. We also thank the following Berkeley Lab staff for their input and review: Ryan Wiser, Galen Barbose, Joe Rand, Will Gorman, Anna Cheyette, Joachim Seel, Julie Mulvaney Kemp and Eric O'Shaughnessy (LBNL affiliate).

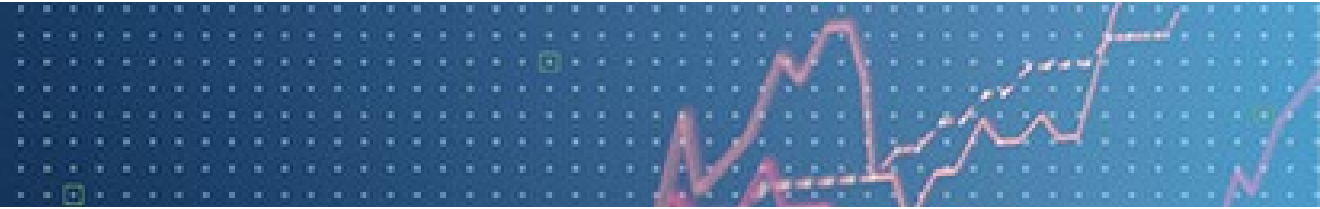

Disclaimer

This document was prepared as an account of work sponsored by the United States Government. While this document is believed to contain correct information, neither the United States Government nor any agency thereof, nor The Regents of the University of California, nor any of their employees, makes any warranty, express or implied, or assumes any legal responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by its trade name, trademark, manufacturer, or otherwise, does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or any agency thereof, or The Regents of the University of California. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof, or The Regents of the University of California.

Ernest Orlando Lawrence Berkeley National Laboratory is an equal opportunity employer.

Copyright Notice

This manuscript has been authored by an author at Lawrence Berkeley National Laboratory under Contract No. DE-AC02-05CH11231 with the U.S. Department of Energy. The U.S. Government retains, and the publisher, by accepting the article for publication, acknowledges, that the U.S. Government retains a non-exclusive, paid-up, irrevocable, worldwide license to publish or reproduce the published form of this manuscript, or allow others to do so, for U.S. Government purposes

Exploring Interconnection Solutions – Reporting Requirements



Considerations for DER Interconnection Reporting Requirements


- Reporting is a relatively simple tool to better understand the scale of interconnection challenges and isolate specific pain points and causes.
- Regulators establish expectations for utilities to provide data on interconnection, grid conditions, and hosting capacity.
- Considerations for guidelines
 - Identify an appropriate proceeding to consider guidelines
 - Solicit stakeholder input to inform data needs and availability
 - Clarify what data are important for utilities and project developers to provide and for what purpose
 - Clarify data sharing formats (e.g. provision of downloadable data in addition to data within hosting capacity maps)
 - Consider sensitivity of data and take appropriate precautions
 - Consider tradeoffs between granularity and frequency of updates considering resource intensity
 - Solicit information from utilities on whether automating interconnection processes can reduce resource intensity associated with reporting, application processing, and customer communications
- Data can inform potential additional regulatory actions, such as establishing maximum timelines and performance incentive mechanisms.



Existing DER Interconnection Reporting Requirements

- Commissions can draw from existing reporting requirements and templates to reduce administrative burden and expedite reporting.
- The following examples include key metrics and ideas for public reporting formats to draw from.

Grid Data Sharing Analysis Framework

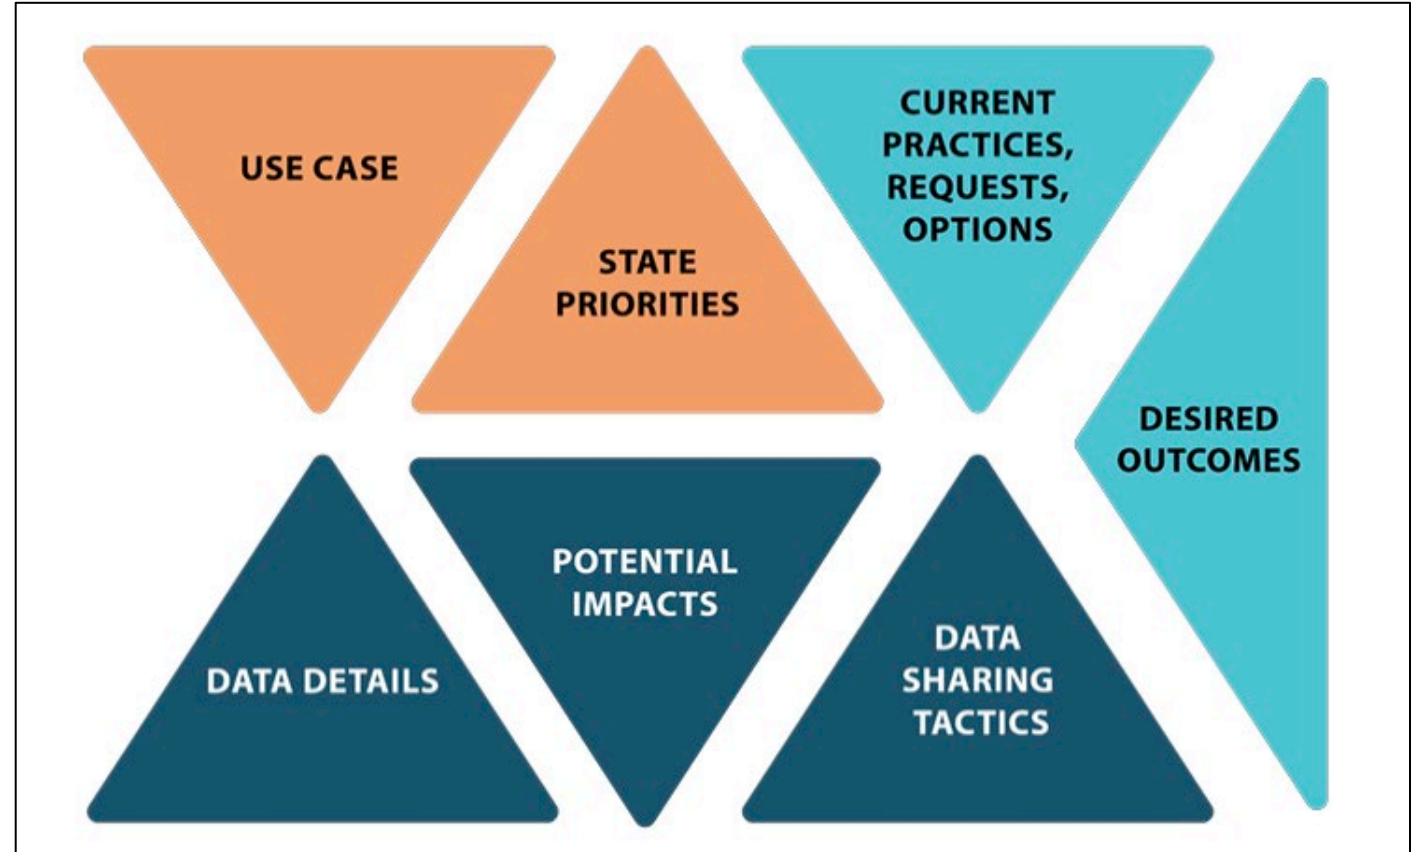

Source: [NARUC Grid Data Sharing Playbook](#)



Existing DER Interconnection Reporting Requirements

DER Interconnection Application Data

DER Applications	Generated by Utilities
<ul style="list-style-type: none"> • Technology • Rated power (kW) • Stored energy (kWh) • IEEE 1547 Reactive Power Category, commonly referred to as “voltage and reactive power capability”⁵⁹ • IEEE Std 1547 Disturbance Category, commonly referred to as “voltage and frequency ride-through capability” • Location (census block group) 	<ul style="list-style-type: none"> • Queue position • Application date and interconnection agreement date • Dates of system impact study start and completion • Construction completion date and permission to operate date • Status (active, operational, withdrawn, suspended) • Technical screen failures and results, if applicable⁶⁰ • Group study status, if applicable • Estimated cost of studies and fees (\$ quoted by the utility) • Estimated cost of all system upgrades, including facilities charges and network upgrades (\$ quoted by the utility) • Final cost of interconnection, including costs of all studies and any required system upgrades (\$ billed by the utility)



Hawaiian Electric – DER Interconnection Reporting (1)

Hawaiian Electric reports on DER interconnection and integration in multiple reports.

Annual reports for the feed-in-tariff (FIT) program (closed) include (all by resource type and size)

- Number of project applications received
- Number and status of projects currently in the queue
- Number of projects completed, interconnected, contract signed
- Total kWh purchased through FITs
- Total amount in dollars of the power purchased through FITs
- Number and duration of curtailments and the reason for each curtailment
- Time spent to complete processing a project application from date of receipt of contract application to interconnecting the project
- Program administration information




Hawaiian Electric – DER Interconnection Reporting (2)

Quarterly reports on current programs

- Available hosting capacity
- Applications executed, under review, and rejected (# and MWs)
- Number of interconnection requirements studies, timelines, types of grid upgrades needed, study costs
- Advanced metrics on volt-watt curtailments, lost compensation, and underlying voltage issues
- Narrative discussion of updates to DER integration progress and challenges

All Islands-Applications Under Review

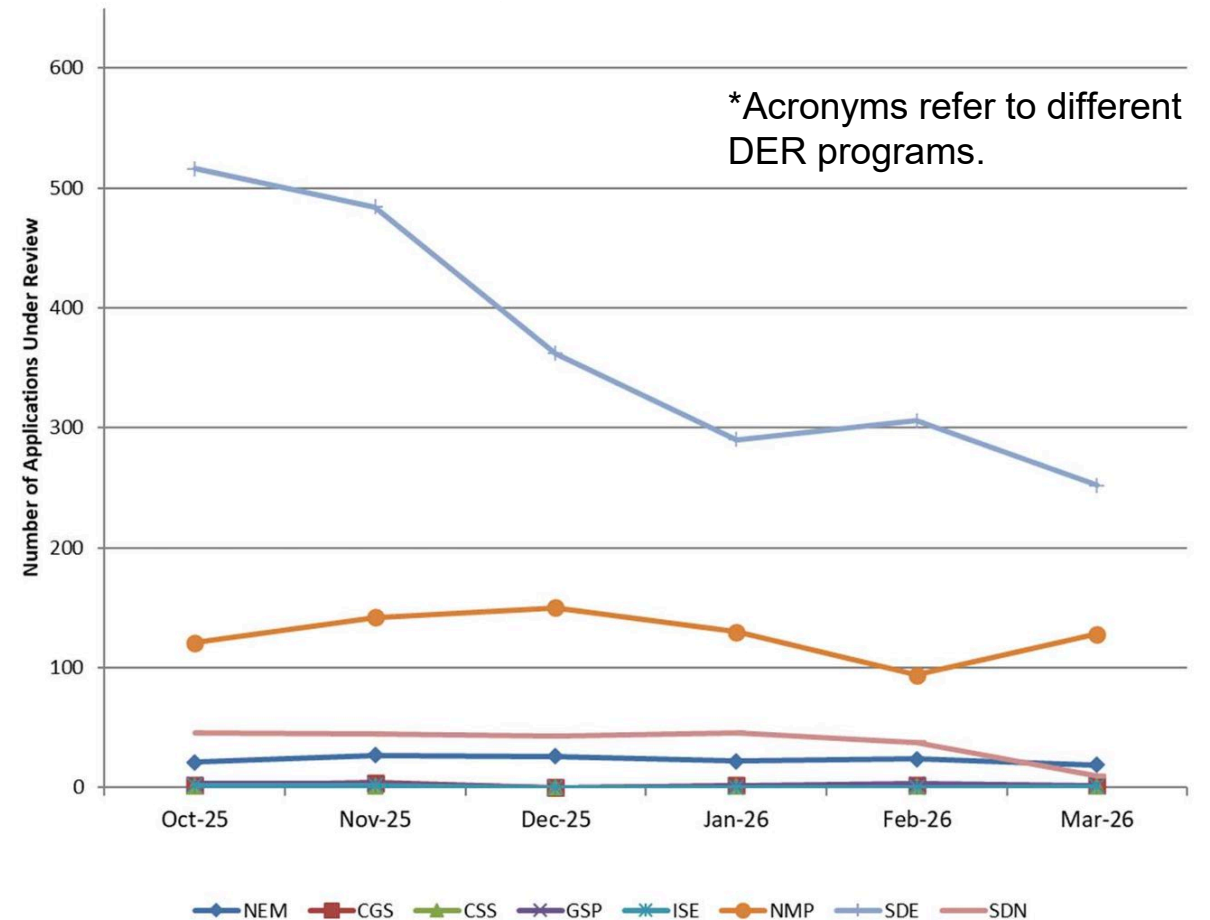

Source: 5/1/26 report filed in Docket [2019-0323](#)



Hawaiian Electric – DER Interconnection Reporting (3)

Biannual Performance-Based Regulation metrics and scorecards

Metric Name	Description
Total DER Interconnection Time	Average total time for all steps in the interconnection process, compared to an annual targeted performance
DER Grid Services Capability	Percentage and total MW of DER systems capable of providing grid services
DER Grid Services Enrollment	Percentage and total MW of capable DER systems enrolled in contracted grid services through aggregators
DER Grid Services Utilization	Utilization of DER systems enrolled in grid service programs
DER Curtailment	Total curtailment in MW and MWh of DER systems with advanced meters


Source: [HECO](#)



Hawaiian Electric – DER Interconnection Reporting (4)


Total DER Interconnection Time by Year
Hawaiian Electric

Publicly available data allow users to see whether utilities are improving over time and create a baseline for performance incentive mechanisms.

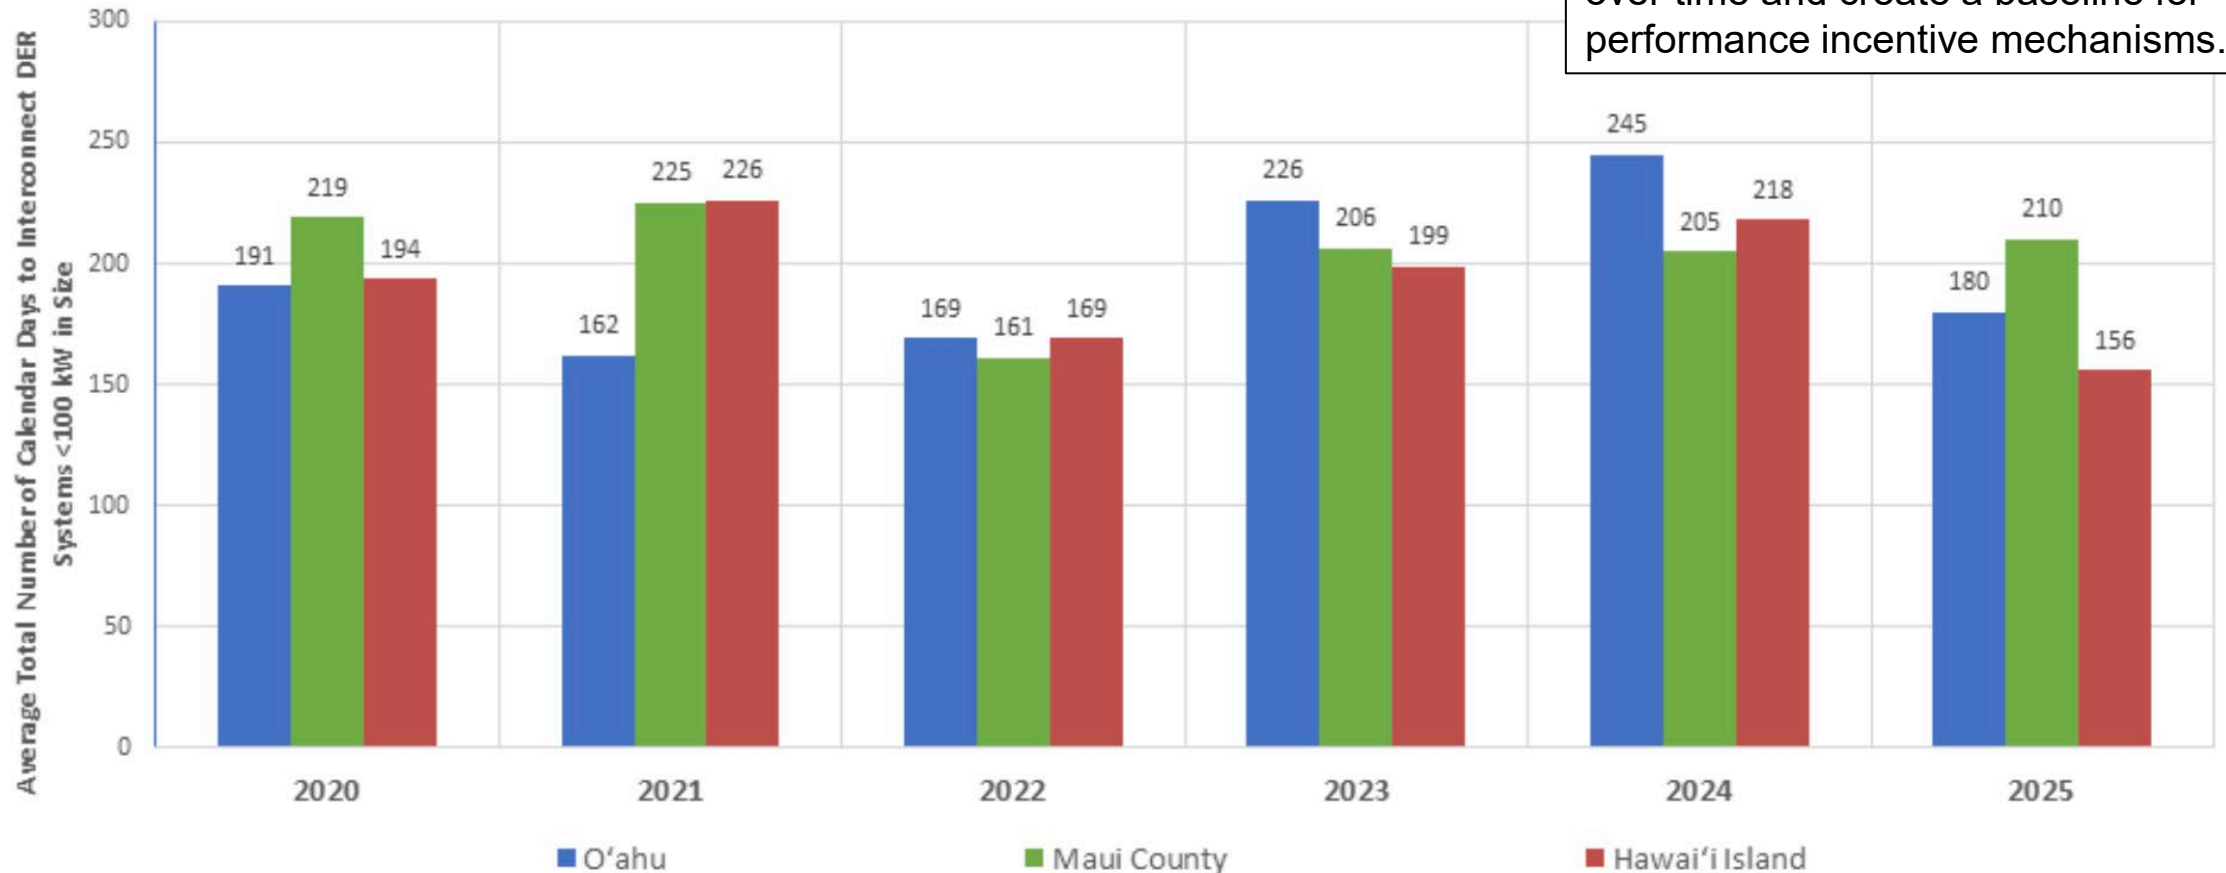

Hawaiian Electric – DER Interconnection Reporting (5)

Total Quantity and Percentage of DER Systems Used to Provide Grid Services (Oahu)

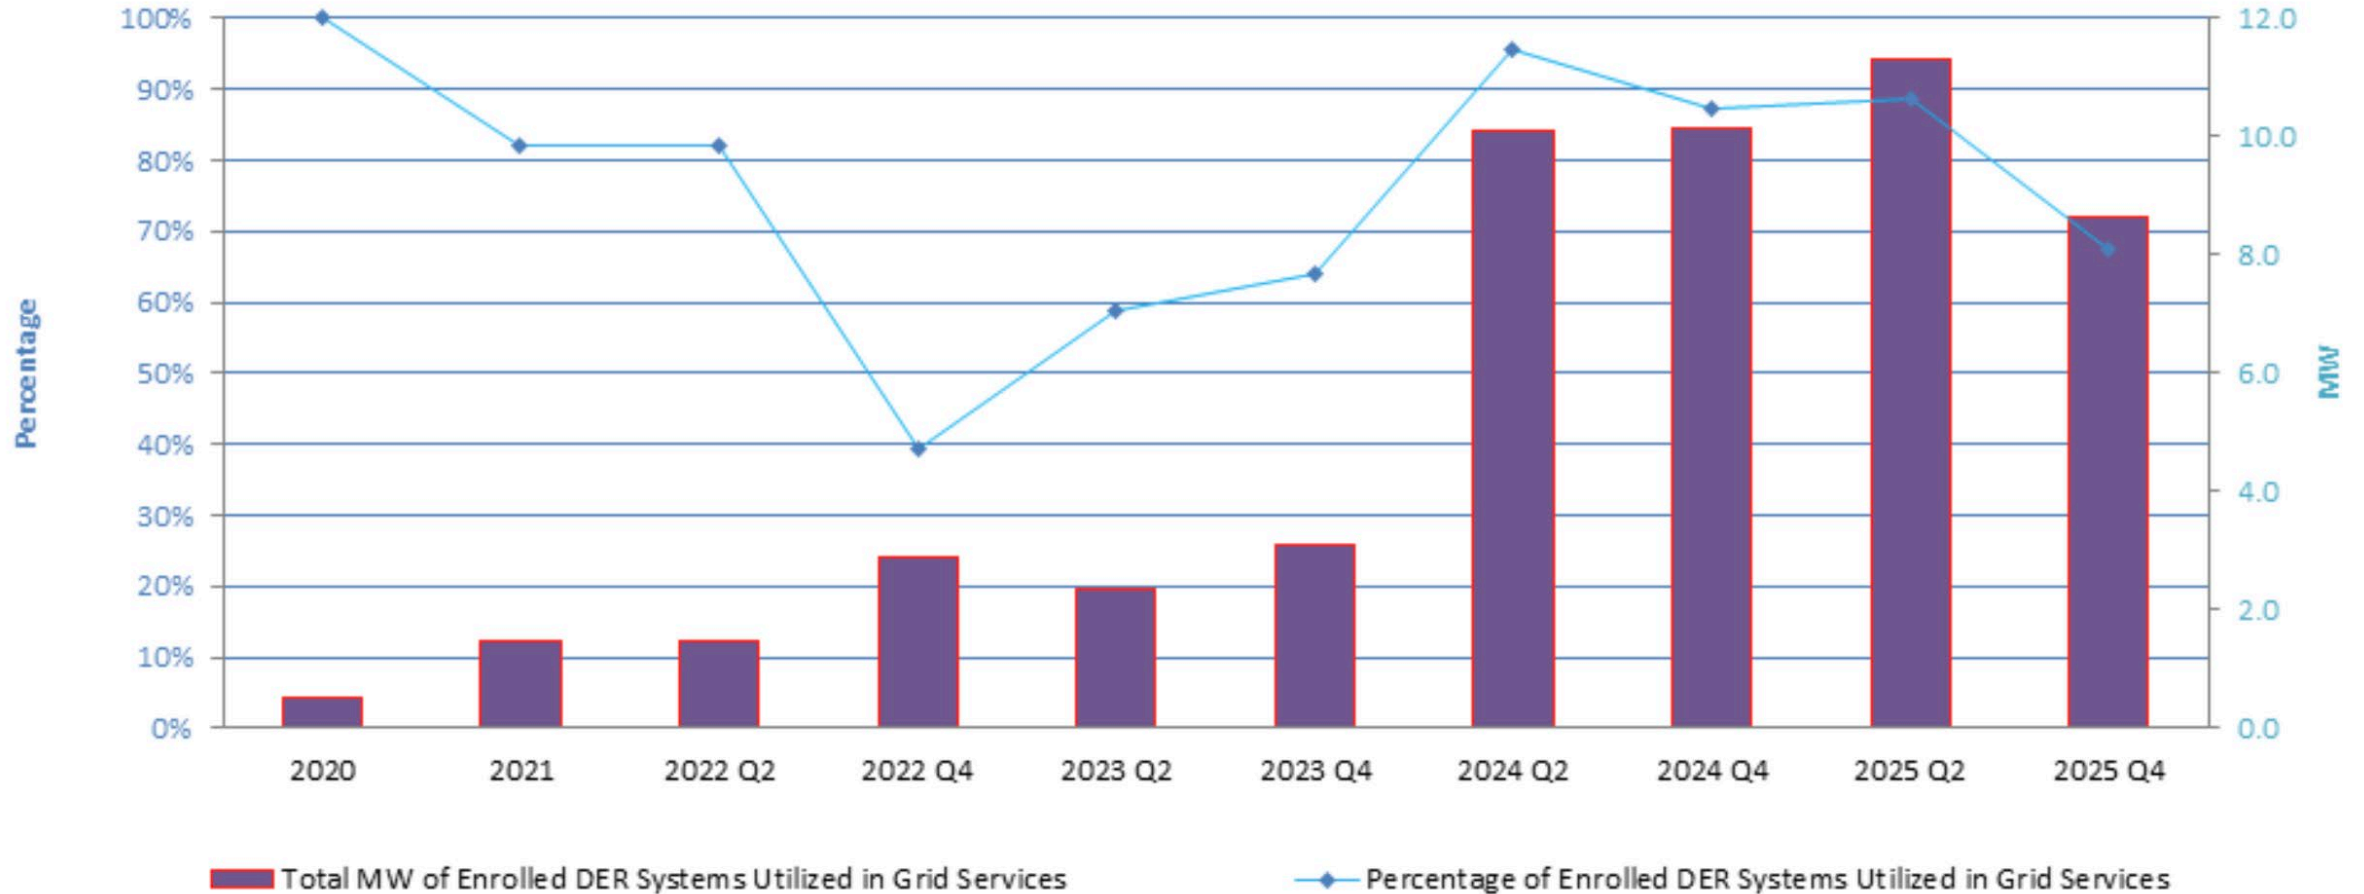

■ Total MW of Enrolled DER Systems Utilized in Grid Services

◆ Percentage of Enrolled DER Systems Utilized in Grid Services



ComEd and Ameren – DER Tracking Metrics

- Amount of DER interconnected – cumulative, annual, behind-the-meter and front-of-the-meter
- Total MW of load shifting capacity of customer-sited energy storage systems
- Number of circuits with 0 kW of estimated hosting capacity
- Amount of hourly energy import and export
- DER projects pending capacity-constrained interconnection
- Number of pending interconnection requests with cost estimate and current status
- Interconnection upgrade cost estimates as compared to actual interconnection cost
- Total costs of interconnection upgrade by project and feeder
- Total time measured in days to complete key milestones of interconnection process

Ameren 2024 Results

F4.1 – Monthly Breakdown of Number and Capacity of Systems in the Interconnection Queue but Waiting to Interconnect Until Upgrades Are Complete

Month	Number of Systems	Aggregate Capacity of Systems (MW)
January	1,155	97,359.2
February	611	102,919.3
March	784	148,610.8
April	1,198	92,027.8
May	1,376	168,539.4
June	1,825	121,589.6
July	1,925	178,615.6
August	2,328	176,751.5
September	1,656	134,183.6
October	1,814	182,322.3
November	1,769	179,787.6
December	608	124,825.9
Total	17,049	1,707,532.5

Sources: [ComEd Tracking Metric Report](#), [Ameren Tracking Metric Report](#)



New York – DER Interconnection Queue Reporting

New York utilities file monthly interconnection queue reports in downloadable Excel format.

- Locational information (town, load zone, circuit ID, substation, etc.)
- Project type and capacity (generation and storage) and protective equipment
- Start date, end date, and associated duration by step in the interconnection process
- Study costs and payments

ConEdison Interconnection Queue Data and Example Timelines

Applying for Private Generation Interconnection

Review eligibility requirements and fill out the interconnection application before starting your project.

Protective Equipment	APPLICATION REVIEW				PRELIMINARY REVIEW		
	Start Date	End Date	Calculated Duration	Application Approved Date (Utility)	Start Date (Must Match Application Approved Date)	End Date	Calculated Duration
			10 business days				15 business days
Inverter	12/31/24						
Inverter	12/31/24						
Inverter	12/31/24						
Inverter	12/31/24						
Inverter	12/31/24						

Source: [New York Department of Public Service](#), [ConEdison](#)



Discussion on Reporting Requirements

- If your state has requirements in place, which data have you found most valuable and how are you using it?
 - What has worked well in your state to facilitate effective reporting and data transparency?
 - What lessons would you share from your experience or what would you like to improve on?
- If your state doesn't have requirements in place, what steps would allow your commission to introduce these types of requirements?
 - Which data do you feel are most critical to start collecting?
- What ideas do you have after today's presentations to improve data reporting in your state?
 - What actions could you take based on the information?
- Would your state benefit from a data reporting template that could be adapted with appropriate modifications?



Next Steps

- **Join i2X Connect to interact with cohort members and other interconnection stakeholders:** <https://groups.energy.gov/i2xconnect/>
- Find all meeting materials at: <https://www.naruc.org/core-sectors/energy-resources-and-the-environment/der-integration-compensation/distributed-energy-projects-interconnection-cohort/>
- **Register for the June 23rd meeting at:** https://naruc-org.zoom.us/webinar/register/WN_Wrm87FGIT6-j7b5oZ74n1A#/registration

Thank you!



Contacts

Grace Relf: gerelf@lbl.gov, 510-926-0943

Jeff Loiter: jloiter@naruc.org, 202-656-2128

Lisa Schwartz: lschwartz@lbl.gov, 510-926-1091

For more information

Download our publications: <https://emp.lbl.gov/publications>

Sign up for our email list: <https://emp.lbl.gov/mailling-list>

Follow us on social media: [@BerkeleyLabEMP.bsky.social](https://www.bsky.social/@BerkeleyLabEMP) and @BerkeleyLabEMP

Acknowledgements

This work was funded by the Interconnection Innovation e-Xchange (i2X), a U.S. Department of Energy initiative supported by the Office of Critical Minerals and Energy Innovation, under Contract No. DE-AC02-05CH11231.

The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof, or The Regents of the University of California.



Disclaimer

This document was prepared as an account of work sponsored by the United States Government. While this document is believed to contain correct information, neither the United States Government nor any agency thereof, nor The Regents of the University of California, nor any of their employees, makes any warranty, express or implied, or assumes any legal responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by its trade name, trademark, manufacturer, or otherwise, does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or any agency thereof, or The Regents of the University of California. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof, or The Regents of the University of California.

Ernest Orlando Lawrence Berkeley National Laboratory is an equal opportunity employer.

Copyright Notice

This manuscript has been authored by an author at Lawrence Berkeley National Laboratory under Contract No. DE-AC02-05CH11231 with the U.S. Department of Energy. The U.S. Government retains, and the publisher, by accepting the article for publication, acknowledges, that the U.S. Government retains a non-exclusive, paid-up, irrevocable, worldwide license to publish or reproduce the published form of this manuscript, or allow others to do so, for U.S. Government purposes

